

ASISAFE ENHANCED SAFETY MONITOR 1 F-RO,
 1 ENABLING CIRCUIT, IP20,
 WITH SPRING-LOADED TERMINALS (REMOVABLE),
 SAFE OUTPUT RELAY RESPONSE TIME MAX. 40 MS,
 MONITOR TYPE 3, VERSION 3,
 APPLICABLE UP TO CATEGORY 4 (EN 954-1),
 UP TO PL E (EN ISO 13849-1),
 UP TO SIL 3 (IEC 61508),
 FOR AS-INTERFACE / AS-I SAFETY AT WORK

General technical data:

Design of the product		safety monitor, with expanded functionality
Protocol / is supported / AS interface protocol		Yes
Type		1 enabling circuit
Number of release circuits		1
Response time / max.	ms	40
Design of the electrical connection / of the inputs and outputs		spring-loaded terminals
Rated operational current Ie		
• AC-12, 50/60 Hz / 250 V	A	3
• AC-15, 50/60 Hz		
• 115 V	A	3
• 230 V	A	3
• DC-12 (DC-1) / 24 V	A	3
• DC-13 (DC-11)		
• 24 V	A	1
• 115 V	A	0.1
• 230 V	A	0.05
Reference code		
• according to DIN 40719 extended according to IEC 204-2 / according to IEC 750		A
• according to DIN EN 61346-2		F

Ambient conditions:

Ambient temperature		
• during operating	°C	60 ... -20
• during storage	°C	70 ... -30
Protection class IP		IP20

Mechanical design:

Width	mm	45
Height	mm	108
Depth	mm	120
Mounting type		screws / standard rail

Certificates/approvals:

General Product Approval

Functional Safety / Safety of Machinery



Declaration of Conformity



EG-Konf.

Shipping Approval



Shipping Approval

other



[Confirmation](#)

[Declaration of Conformity](#)

[Environmental Confirmations](#)

Further information:

Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/industrial-controls/catalogs>

Industry Mall (Online ordering system)

<http://www.siemens.com/industrial-controls/mall>

CAX-Online-Generator


<http://www.siemens.com/cax>

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<http://support.automation.siemens.com/WW/view/en/3RK1105-1AG04-2CA0/all>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)

http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3RK1105-1AG04-2CA0

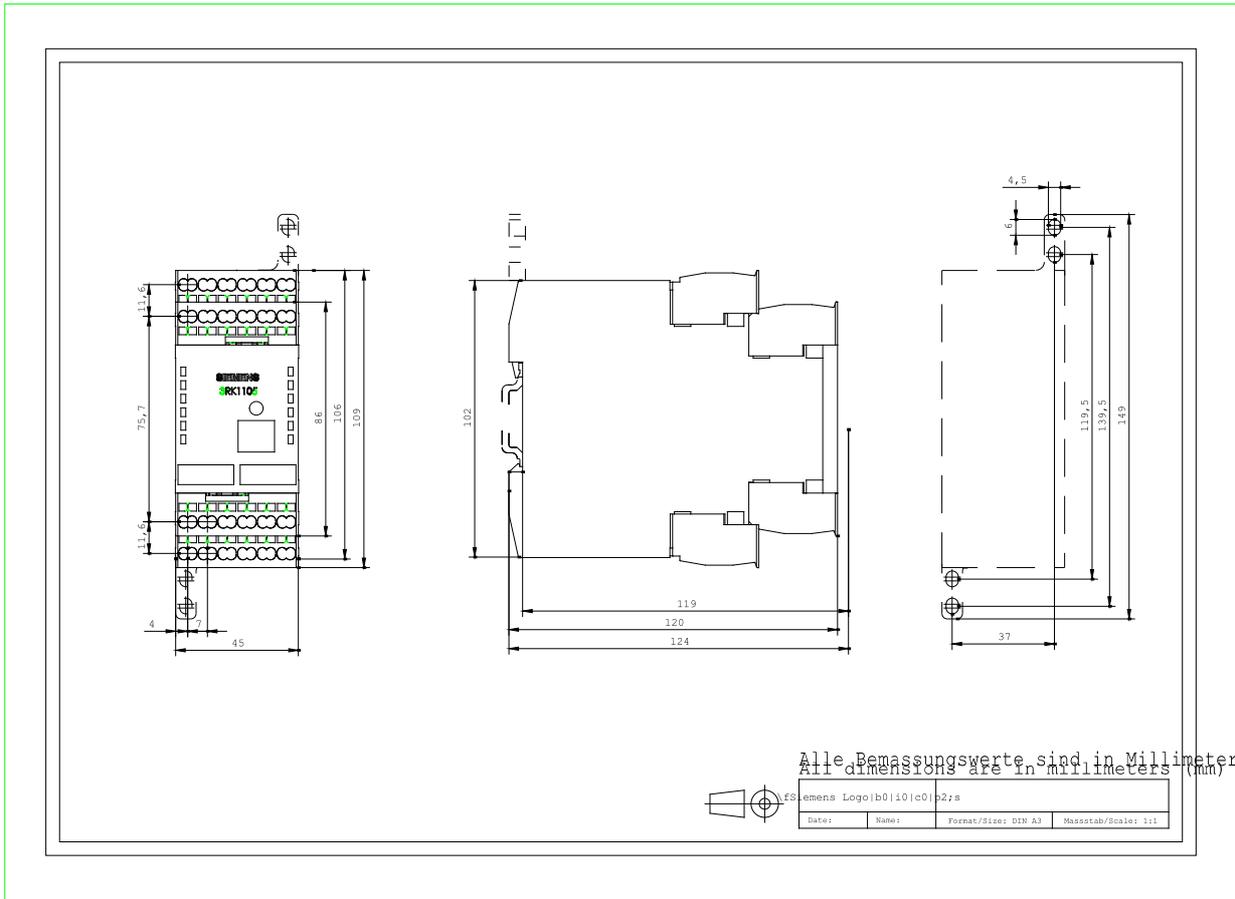

last change:

Jul 7, 2014