



TEMPERATURE MONITORING RELAY PT100/1000,
KTY83/84, NTC 2 THRESHOLDS,
DIGITAL -58 DEG. F TO 932 DEG. F 24 V AC/DC 2 X 1 W +
1 NO,
WIDTH 45 MM CAGE-CLAMP CONNECTION

General technical details:		
type of voltage		AC/DC
Supply voltage frequency		
• 1 / for auxiliary and control current circuit		
• initial rated value	Hz	50
• final rated value	Hz	60
Control supply voltage		
• 1		
• at 50 Hz / for AC		
• rated value	V	24
• at 60 Hz / for AC		
• rated value	V	24
• for DC		
• rated value	V	24
Number of measuring circuits		1
Number of NC contacts / for auxiliary contacts		0
Number of NO contacts / for auxiliary contacts		1
Number of change-over switches / for auxiliary contacts		2
Product function		
• defect storage		Yes

• reset external		Yes
Measurable Fahrenheit-temperature		
• initial value	°F	-58
• final value	°F	932
Item designation / according to DIN EN 61346-2		K
Item designation / according to DIN 40719 extendable after IEC 204-2 / according to IEC 750		K
Ambient temperature		
• during operating	°C	-25 ... +60

Mechanical design:

Design of the electrical connection		
• for auxiliary and control current circuit		spring-loaded terminals
• jumper socket		Yes
Design of the sensor / connectable		PT100/1000, KTY83/84, NTC (resistance sensors)
Width	mm	45
Height	mm	108
Depth	mm	91

Certificates/approvals:

General Product Approval	Test Certificates	other
 GOST	 UL	Special Test Certificate Declaration of Conformity Environmental Confirmations

Further information:

Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/industrial-controls/catalogs>

Industry Mall (Online ordering system)

<http://www.siemens.com/industrial-controls/mall>

CAX-Online-Generator



<http://www.siemens.com/cax>

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<http://support.automation.siemens.com/WW/view/en/3RS2040-2GD50/all>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)

http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3RS2040-2GD50

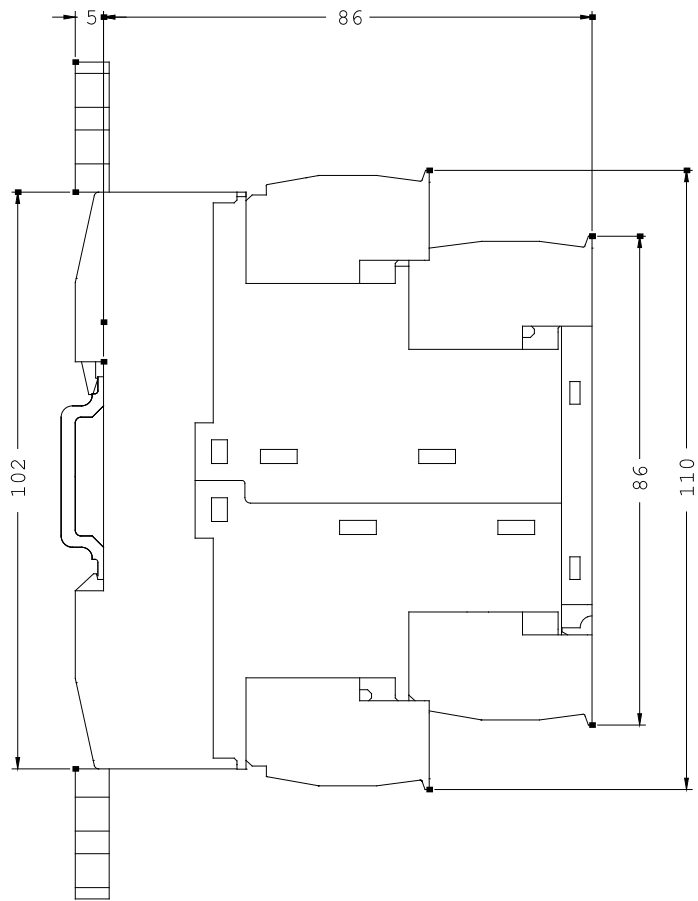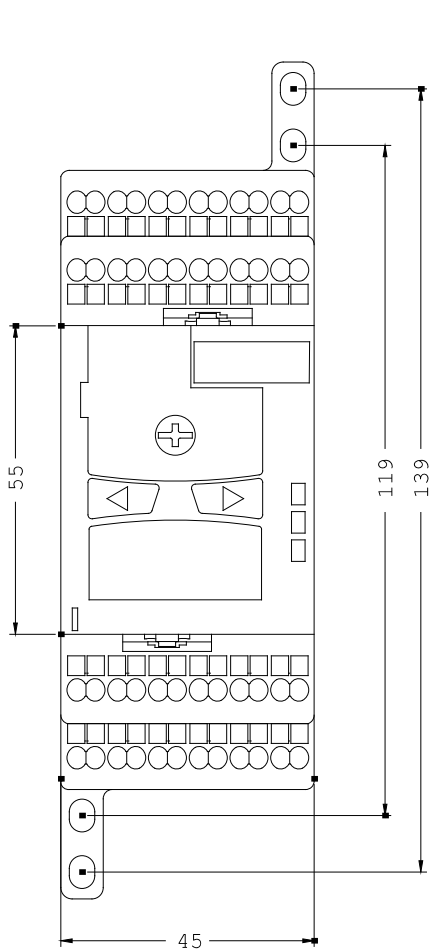

last change:

Jan 25, 2013