

GEMO TEST



General technical details:		
type of voltage		AC/DC
Supply voltage frequency		
• 1 / for auxiliary and control current circuit		
• initial rated value	Hz	50
• final rated value	Hz	60
Control supply voltage		
• 1		
• at 50 Hz / for AC		
• initial rated value	V	24
• final rated value	V	240
• at 60 Hz / for AC		
• initial rated value	V	24
• final rated value	V	240
• for DC		
• initial rated value	V	24
• final rated value	V	240
Number of measuring circuits		1
Number of NC contacts / for auxiliary contacts		0
Number of NO contacts / for auxiliary contacts		1

Number of change-over switches / for auxiliary contacts		2
Product function		
• defect storage		Yes
• reset external		Yes
Measurable Fahrenheit-temperature		
• initial value	°F	-99
• final value	°F	1,830
Item designation / according to DIN EN 61346-2		K
Item designation / according to DIN 40719 extendable after IEC 204-2 / according to IEC 750		K
Ambient temperature		
• during operating	°C	-25 ... +60

Mechanical design:

Design of the electrical connection		
• for auxiliary and control current circuit		spring-loaded terminals
• jumper socket		Yes
Design of the sensor / connectable		type J, K, T, E, N (thermocouple)
Width	mm	45
Height	mm	108
Depth	mm	91

Certificates/approvals:

General Product Approval



GOST



UL

Test Certificates

[Special Test Certificate](#)

other

[Declaration of Conformity](#)

[Environmental Confirmations](#)

Further information:

Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/industrial-controls/catalogs>

Industry Mall (Online ordering system)

<http://www.siemens.com/industrial-controls/mall>

CAX-Online-Generator



<http://www.siemens.com/cax>

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<http://support.automation.siemens.com/WW/view/en/3RS2140-2GW60/all>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)

http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3RS2140-2GW60

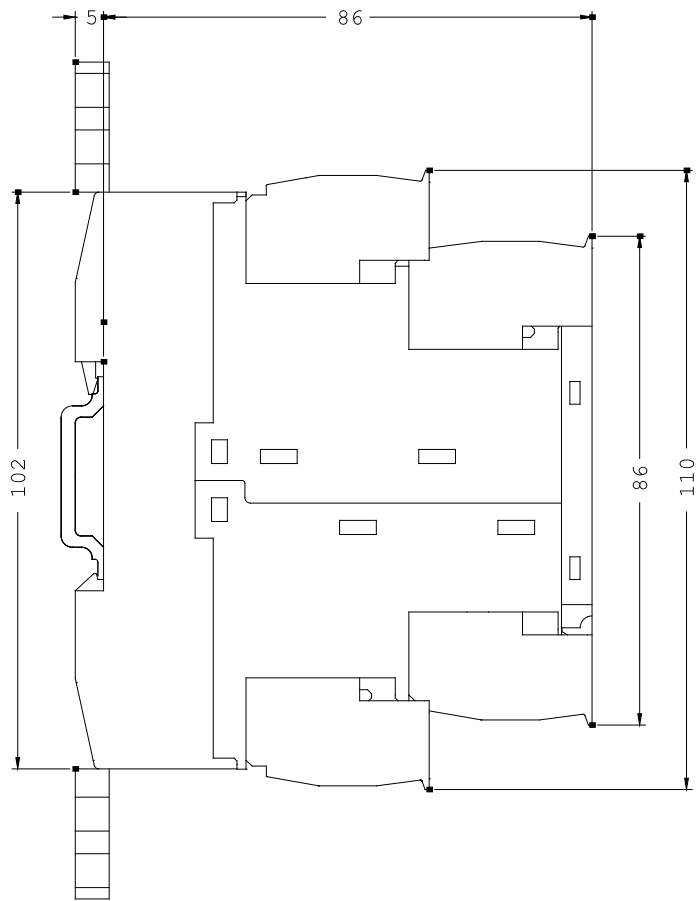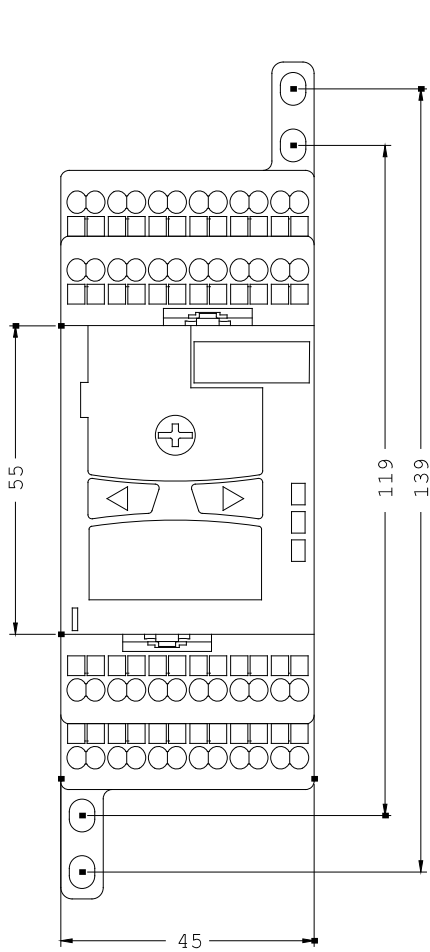

last change:

Jan 25, 2013