



MECHANICAL LATCHING BLOCK FOR MOUNTING ON
3RT1.2. AND 3RT1.3.,
24 V AC/DC

General technical data:

product brand name		SIRIUS
Product designation		mechanical latch
Size of the contactor		S0, S2
Protection class IP / on the front		IP20
Insulation voltage / with degree of pollution 3		
• rated value	V	690
Ambient temperature		
• during storage	°C	-50 ... +80
• during operating	°C	-25 ... +60

Auxiliary circuit:

Number of NC contacts		
• for auxiliary contacts		0
Number of NO contacts		
• for auxiliary contacts		0

Control circuit:

Voltage type / of control feed voltage		AC/DC
--	--	-------

Installation/mounting/dimensions:

Mounting type		clip-on
mounting position		any

Connections:

Design of the electrical connection

- for auxiliary and control current circuit

screw-type terminals

Type of the connectable conductor cross-section

- for auxiliary contacts
 - solid
 - finely stranded
 - with conductor end processing
- for AWG conductors / for auxiliary contacts

2x (0.5 ... 2.5 mm²), 1x 4 mm²

2x (0.5 ... 2.5 mm²), 1x 2.5 mm²

2x 14, 1x 12

Certificates/approvals:

Verification of suitability

CE / UL / CSA / CCC

General Product Approval

Functional Safety / Safety of Machinery

Declaration of Conformity

Test Certificates



[Type Examination](#)



[Special Test Certificate](#)

Shipping Approval



Shipping Approval

other



[Confirmation](#)

[Declaration of
Conformity](#)

[other](#)

[Environmental
Confirmations](#)

Further information:

Information- and Downloadcenter (Catalogs, Brochures,...)

<http://www.siemens.com/industrial-controls/catalogs>

Industry Mall (Online ordering system)

<http://www.siemens.com/industrial-controls/mall>

CAX-Online-Generator




<http://www.siemens.com/cax>

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<http://support.automation.siemens.com/WW/view/en/3RT1926-3AB31/all>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)

http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3RT1926-3AB31

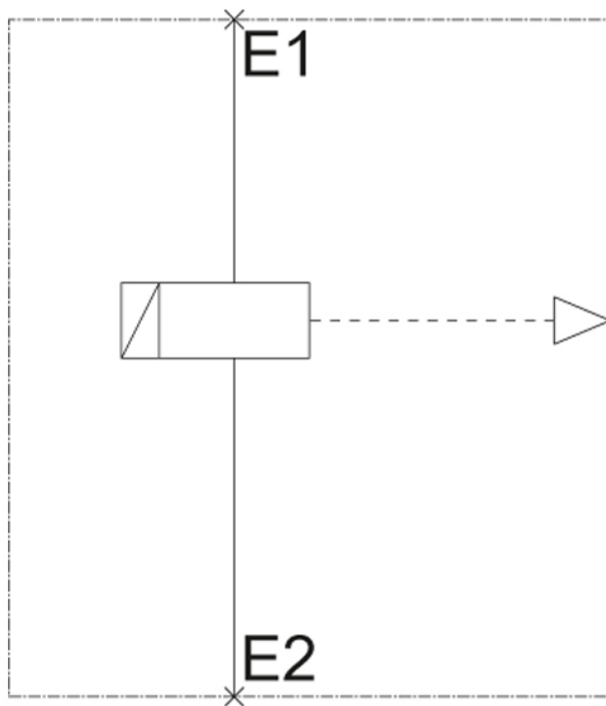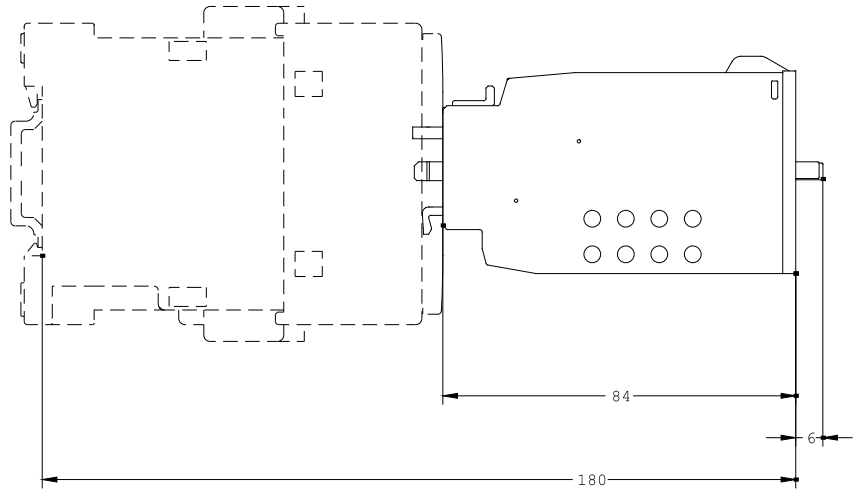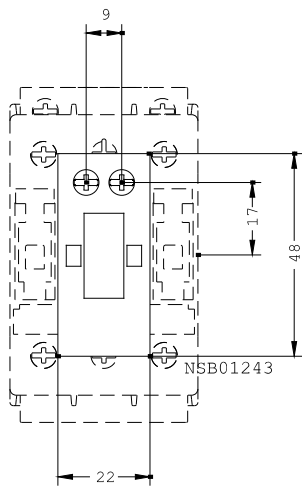

last change:

Jul 28, 2014