


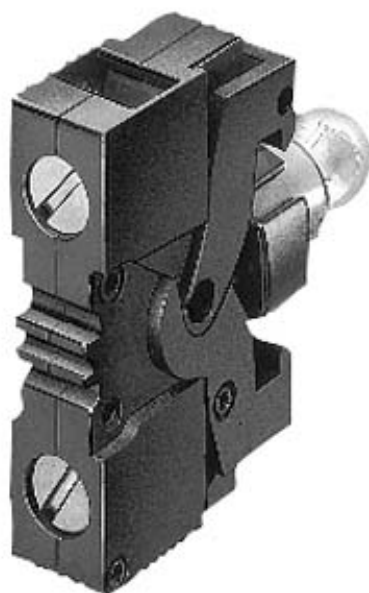

ACTUATOR-/INDICATOR COMPONENT W. SEPARATE
LAMP TEST FUNCTION LAMP HOLDER BA 9S WITHOUT
LAMP,
FOR LAMP MAX.2.6W SCREW TERMINAL RATED
VOLTAGE ACC.TO LAMP SUITABLE F LED 24/48/230V
AC/DC

Contact block/ lampholder:

Product designation		lampholder
Number of NC contacts / for auxiliary contacts		0
Number of NO contacts / for auxiliary contacts		0
Number of changeover contacts / for auxiliary contacts		0
Product function / positive opening		No
Number of lampholders		1
Execution of the mounting		BA 9s
Design of the electrical connection		screw-type terminals

General technical data:

Degree of pollution		class 3
Voltage type / of operating voltage		AC/DC
Reference code		P H
• according to DIN EN 61346-2 • according to DIN 40719 extended according to IEC 204-2 / according to IEC 750		
Ambient temperature		
• during operating	°C	-25 ... +60
• during storage	°C	-25 ... +80
protection type IP		

• of the terminal		IP20
• of the enclosure		IP40
Operating voltage		
• at 50 Hz / at AC / rated value	V	6 ... 230
• at 60 Hz / at AC / rated value	V	6 ... 230
• for DC		
• rated value	V	6 ... 230
Suitability for integration		
• pressure selection button		Yes
• front element		Yes
• suspension switch		Yes
• suspension pushbutton		Yes
Insulation voltage / rated value	V	250
Impulse voltage resistance / rated value	kV	4
Tightening torque / for auxiliary contacts / with screw-type terminals	N·m	0.8
Product component		
• fluorescent materials		No
• diode		No
• lamp transformer		No
• series resistance		Yes
Mounting type		front mounting
Width	mm	10
Height	mm	45.9
Depth	mm	36.8

Connections/ terminals:

Type of the connectable conductor cross-section

- for auxiliary contacts / solid
- for auxiliary contacts / solid / with conductor end processing
- for auxiliary contacts / finely stranded / with conductor end processing
- for AWG conductors / for auxiliary contacts

2x (1.0 ... 1.5 mm²)
2x (0.5 ... 0.75 mm²)
2x (0.5 ... 1.5 mm²)
2x (18 ... 14)

Certificates/ approvals:

General Product Approval

Declaration of Conformity


other



[Confirmation](#)

[Environmental Confirmations](#)

Further information:

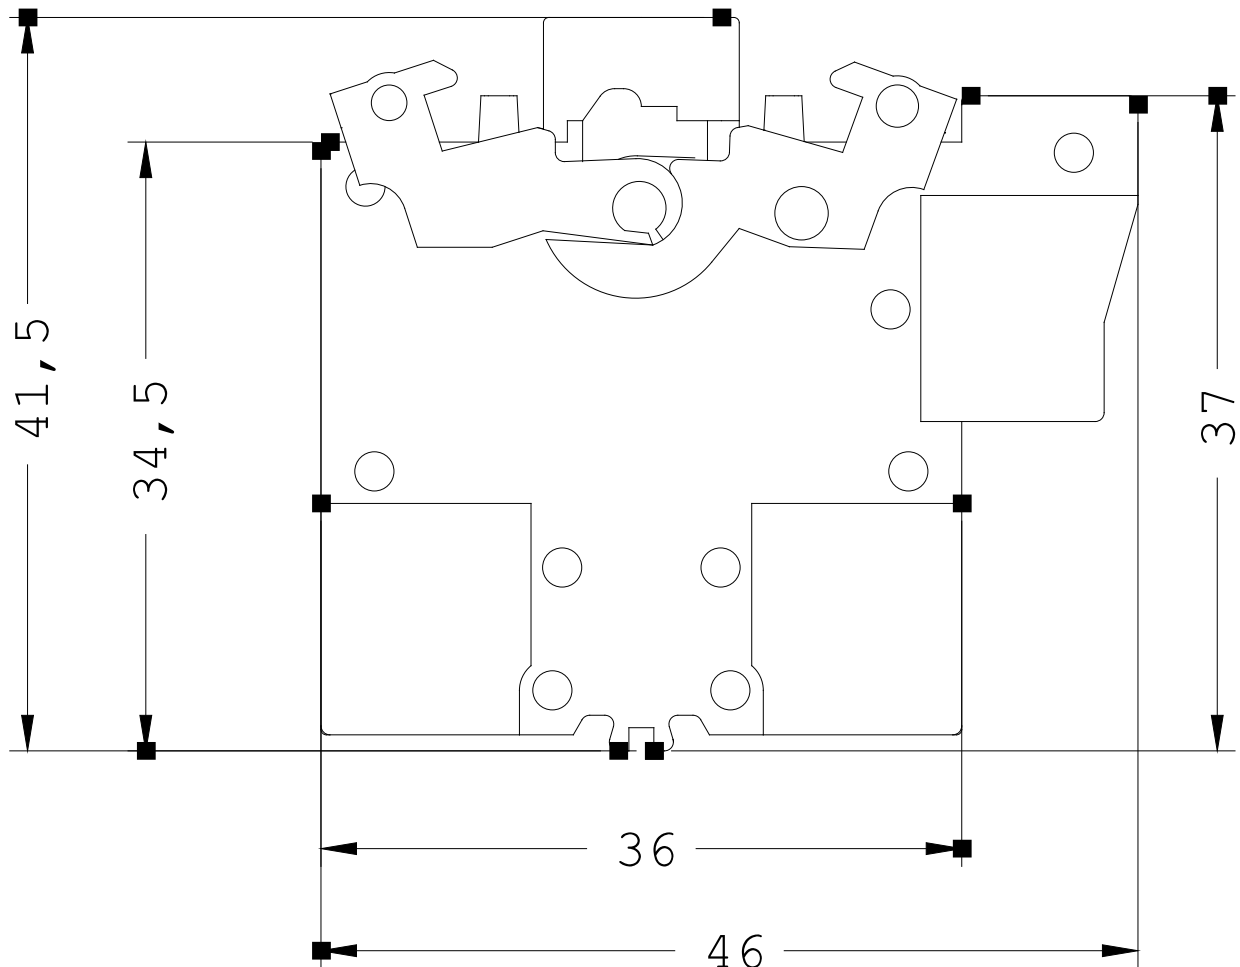

last change:

Jun 16, 2014